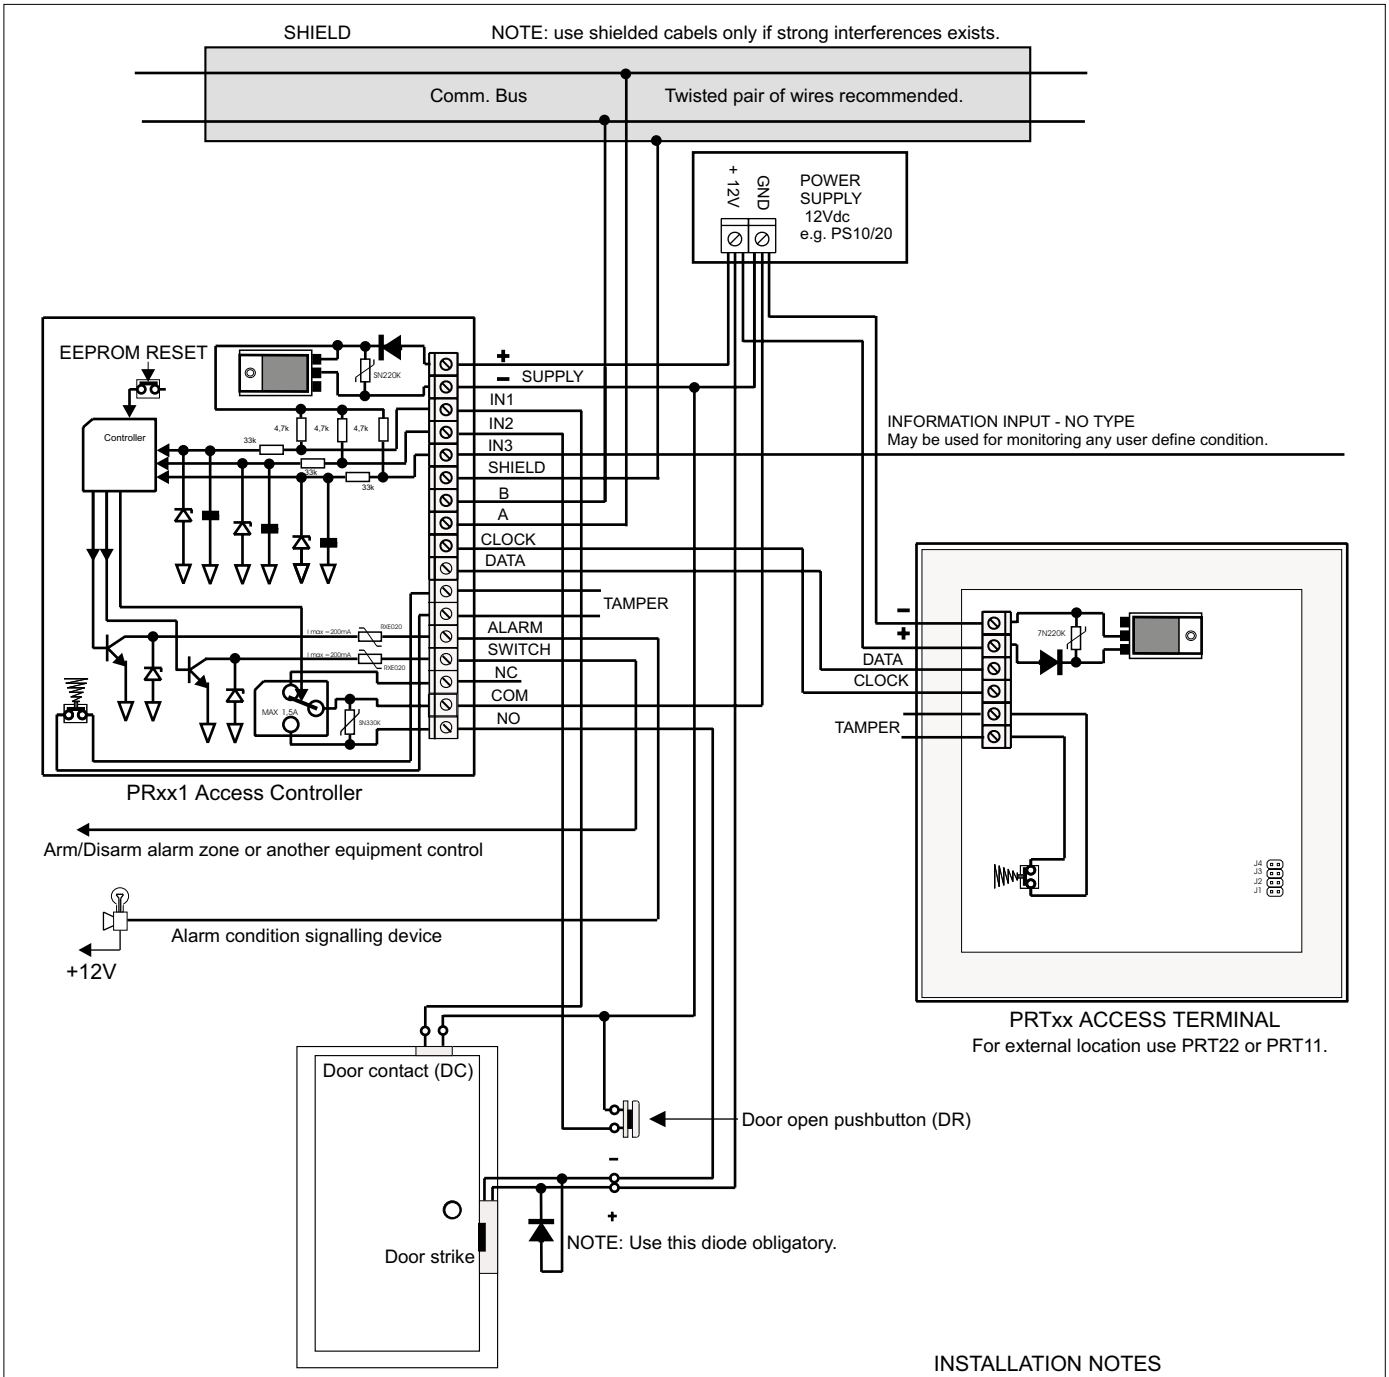

INSTALLATION NOTES

Comm. Bus max lenght - 1000m.
The max. Distance between controller and terminal - 300m.

The max. voltage droop between controller and power supply must not exceed 1V level, for larger values reduce supply wire resistance.

Door strike must be supply with separate pair of wires.

Typical connection diagram of PRxx1 access controller.

PR_033UK.cdr